

For F2164 ELECTRIC STRIKE with  
LATCH MONITOR SWITCH




### Latch Monitor Wires

Black = Common (C)  
Blue = Normally Closed (NC)  
Orange = Normally Open (NO)

**Switch Type:** SPDT

**Switch Rating:** 2 Amp @ 24 VDC

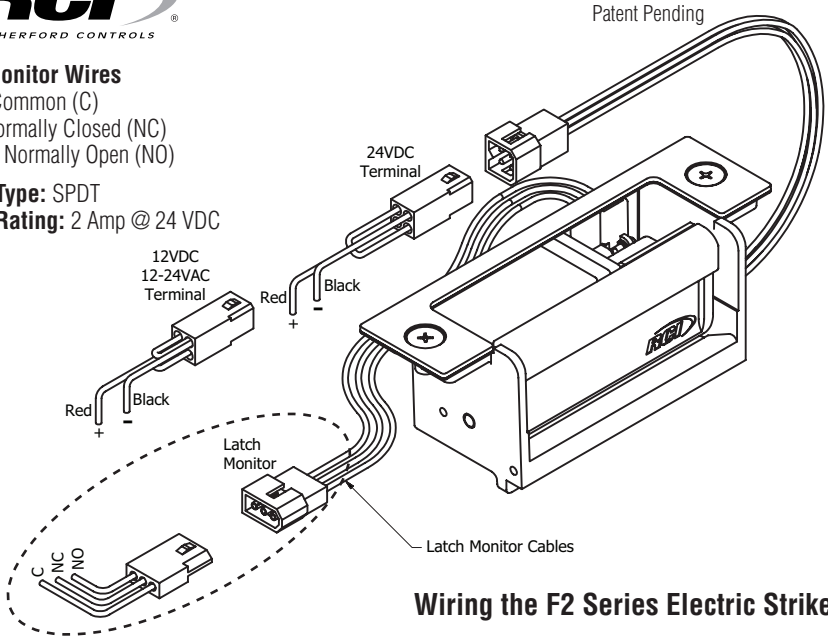

### Adjust Latch Monitor Module:

- Step 1: Carefully remove faceplate from strike insert (Make sure the deadbolt and deadlatch alignments don't change).
- Step 2: Move the door towards the strike so that the latch touches the keeper.
- Step 3: Mark latch limit lines on keeper (Fig.1).
- Step 4: Open the door, mount the Latch Monitor Module on the strike housing so that it is between the latch limit lines marked on keeper.
- Step 5: Make electrical connection, position the faceplate onto the strike and secure to the frame.  
NOTE: To avoid pinching wires ensure wires run through wiring channel before inserting strike into frame. (see Fig. 2)

Fig.1



Fig.2

